



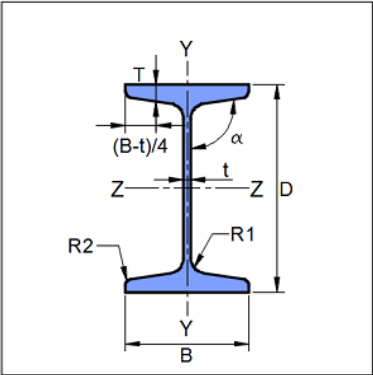

Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

1 Input Parameters

Main Module		Shear Connection		
Module		Cleat Angle		
Connectivity		Column Flange-Beam Web		
Shear Force (kN)		130.0		
Supporting Section - Mechanical Properties				
	Supporting Section		HB 250	
	Material		E 250 (Fe 410 W)A	
	Ultimate Strength, Fu (MPa)		410	
	Yield Strength, Fy (MPa)		250	
	Mass, m (kg/m)	50.98	Iz (cm4)	7730.0
	Area, A (cm2)	64.9	Iy(cm4)	1960.0
	D (mm)	250.0	rz (cm)	10.9
	B (mm)	250.0	ry (cm)	5.49
	t (mm)	6.9	Zz (cm3)	619.0
	T (mm)	9.7	Zy (cm3)	156.0
	Flange Slope	94	Zpz (cm3)	678.0
	R1 (mm)	10.0	Zpy (cm3)	262.0
	R2 (mm)	5.0		
	Supported Section - Mechanical Properties			
	Supported Section		MB 300	
	Material		E 250 (Fe 410 W)A	
	Ultimate Strength, Fu (MPa)		410	
	Yield Strength, Fy (MPa)		250	
	Mass, m (kg/m)	46.02	Iz (cm4)	8990.0
	Area, A (cm2)	58.6	Iy(cm4)	486.0
	D (mm)	300.0	rz (cm)	12.3
	B (mm)	140.0	ry (cm)	2.87
	t (mm)	7.7	Zz (cm3)	599.0
	T (mm)	13.1	Zy (cm3)	69.4
	Flange Slope	98	Zpz (cm3)	681.0
	R1 (mm)	14.0	Zpy (cm3)	117.0
	R2 (mm)	7.0		
	Bolt Details - Input and Design Preference			

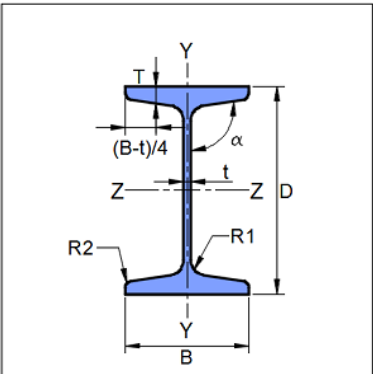

Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Diameter (mm)	[16, 20]
Property Class	[4.6, 4.8]
Type	Bearing Bolt
Hole Type	Standard
Slip Factor, (μ_f)	0.3
Detailing - Design Preference	
Edge Preparation Method	Rolled, machine-flame cut, sawn and planed
Gap Between Members (mm)	10.0
Are the Members Exposed to Corrosive Influences?	False

1.1 List of Input Section

Cleat Angle List	'90 x 90 x 10', '90 x 90 x 12', '100 x 100 x 6', '100 x 100 x 8'
------------------	--



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

2 Design Checks

Design Status	Pass
---------------	------

2.1 Selected Member Data

	Section Size		90 x 90 x 10	
	Material		E 250 (Fe 410 W)A	
	Ultimate Strength, Fu (MPa)		410	
	Yield Strength, Fy (MPa)		250	
	Mass, m (kg/m)	13.47	I_u (cm ⁴)	205.0
	Area, A (cm ²)	17.1	I_v (cm ⁴)	53.6
	A (mm)	90.0	r_z (cm)	2.75
	B (mm)	90.0	r_y (cm)	2.75
	t (mm)	10.0	r_u (cm)	3.46
	R_1 (mm)	8.5	r_v (cm)	1.77
	R_2 (mm)	0.0	Z_z (cm ³)	20.2
	C_y (mm)	26.0	Z_y (cm ³)	20.2
	C_z (mm)	26.0	Z_{pz} (cm ³)	36.4
	I_z (cm ⁴)	129.0	Z_{py} (cm ³)	20.2
	I_y (cm ⁴)	129.0		

2.2 Initial Section Check

Check	Required	Provided	Remarks
Shear Yielding Capacity (kN)	130.0	$V_{dy} = \frac{A_v f_y}{\sqrt{3} \gamma_{mo}}$ $= \frac{300.0 \times 7.7 \times 250}{\sqrt{3} \times 1.1 \times 1000}$ $= 303.11$ [Ref.IS 800 : 2007, Cl.10.4.3]	Pass
Allowable Shear Capacity (kN)	130.0	$V_d = 0.6 V_{dy}$ $= 0.6 \times 303.11$ $= 181.87$ [Limited to low shear]	Pass



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

2.3 Load Consideration

Check	Required	Provided	Remarks
Applied Shear Force (kN)	130.0	$V_{y_{min}} = \min(0.15 \times V_{dy}, 40.0)$ $= \min(0.15 \times 303.11, 40.0)$ $= 40$ $V_u = \max(V_y, V_{y_{min}})$ $= \max(130.0, 40)$ $= 130.0$ [Ref. IS 800 : 2007, Cl. 10.7]	

2.4 Bolt Design - Connected to Beam

Check	Required	Provided	Remarks
Diameter (mm)		20	
Property Class		4.6	
Cleat Angle		90 x 90 x 10	
No. of Bolt Columns		1	
No. of Bolt Rows		3	
Min. Pitch Distance (mm)	$p_{min} = 2.5 d$ $= 2.5 \times 20$ $= 50.0$ [Ref IS 800 : 2007, Cl. 10.2.2]	75	Pass
Max. Pitch Distance (mm)	$p_{max} = \min(32 t, 300 \text{ mm})$ $= \min(32 \times 7.7, 300 \text{ mm})$ $= \min(246.4, 300 \text{ mm})$ $= 246.4$ Where, $t = \min(10.0, 7.7)$ [Ref. IS 800 : 2007, Cl. 10.2.3]	75	Pass



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Min. Gauge Distance (mm)	$g_{min} = 2.5 d$ $= 2.5 \times 20$ $= 50.0$ [Ref IS 800 : 2007, Cl. 10.2.2]	N/A	
Max. Gauge Distance (mm)	$g_{max} = \min(32 t, 300 \text{ mm})$ $= \min(32 \times 7.7, 300 \text{ mm})$ $= \min(246.4, 300 \text{ mm})$ $= 246.4$ Where, $t = \min(10.0, 7.7)$ [Ref. IS 800 : 2007, Cl. 10.2.3]	N/A	
Min. End Distance (mm)	$e_{min} = 1.5 d_0$ $= 1.5 \times 22.0$ $= 33.0$ [Ref. IS 800 : 2007, Cl. 10.2.4.2]	35	Pass
Max. End Distance (mm)	$e_{max} = 12 t \varepsilon; \varepsilon = \sqrt{\frac{250}{f_y}}$ $e_1 = 12 \times 10.0 \times \sqrt{\frac{250}{250}} = 120.0$ $e_2 = 12 \times 7.7 \times \sqrt{\frac{250}{250}} = 92.4$ $e_{max} = \min(e_1, e_2) = 92.4$ [Ref. IS 800 : 2007, Cl. 10.2.4.3]	35	Pass
Min. Edge Distance (mm)	$e'_{min} = 1.5 d_0$ $= 1.5 \times 22.0$ $= 33.0$ [Ref. IS 800 : 2007, Cl. 10.2.4.2]	35	Pass



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Max. Edge Distance (mm)	$e'_{max} = 12 t \varepsilon; \varepsilon = \sqrt{\frac{250}{f_y}}$ $e_1 = 12 \times 10.0 \times \sqrt{\frac{250}{250}} = 120.0$ $e_2 = 12 \times 7.7 \times \sqrt{\frac{250}{250}} = 92.4$ $e'_{max} = \min(e_1, e_2) = 92.4$ <p>[Ref. IS 800 : 2007, Cl. 10.2.4.3]</p>	35	Pass
Moment Demand (kNm)		$M_d = (V_u \times ecc + M_w)$ <p><i>ecc = eccentricity</i> <i>M_w = external moment acting on web</i></p> $= \frac{(130.0 \times 10^3 \times 53.5 + 0.0 \times 10^6)}{10^6}$ $= 6955.0$	
Bolt Force Parameter(s) (mm)	$l_n = \text{length available}$ $l_n = p (n_r - 1)$ $= 75 \times (3 - 1)$ $= 150$ $y_{max} = l_n / 2$ $= 150 / 2$ $= 75.0$ $x_{max} = g(n_c - 1) / 2$ $= 0.0 \times (1 - 1) / 2$ $= 0.0$		



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Bolt.Force (kN)	$v_b v_u = V_u / (n_r \times n_c)$ $= \frac{130.0}{(3 \times 1)}$ $= 43.33$ $t_m h = \frac{M_d \times y_{max}}{\sum r_i^2}$ $= \frac{6955.0 \times 75.0}{11.25}$ $= 46.37$ $t_m v = \frac{M_d \times x_{max}}{\sum r_i^2}$ $= \frac{6955.0 \times 0.0}{11.25}$ $= 0.0$ $a_b h = \frac{A_u}{(n_r \times n_c)}$ $= \frac{0.0}{(3 \times 1)}$ $= 0.0$ $v_{res} = \sqrt{(v_b v_u + t_m v)^2 + (t_m h + a_b h)^2}$ $= \sqrt{(43.33 + 0.0)^2 + (46.37 + 0.0)^2}$ $= 63.46$		
Shear Capacity (kN)		$V_{dsb} = \frac{f_{ub} n_n A_{nb}}{\sqrt{3} \gamma_{mb}}$ $= \frac{400.0 \times 2 \times 245}{1000 \times \sqrt{3} \times 1.25}$ $= 90.53$ [Ref. IS 800 : 2007, Cl. 10.3.3]	



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Kb		$k_b = \min \left(\frac{e}{3d_0}, \frac{p}{3d_0} - 0.25, \frac{f_{ub}}{f_u}, 1.0 \right)$ $= \min \left(\frac{35}{3 \times 22.0}, \frac{75}{3 \times 22.0} - 0.25, \frac{400.0}{410}, 1.0 \right)$ $= \min(0.53, 0.89, 0.98, 1.0)$ $= 0.53$ <p>[Ref. IS 800 : 2007, Cl. 10.3.4]</p>	
Bearing Capacity (kN)		$V_{dpb} = \frac{2.5 k_b d t f_u}{\gamma_{mb}}$ $= \frac{2.5 \times 0.53 \times 20 \times 7.7 \times 410}{1000 \times 1.25}$ $= 66.93$ <p>[Ref. IS 800 : 2007, Cl. 10.3.4]</p>	
Capacity (kN)		$V_{db} = \min (V_{dsb}, V_{dpb})$ $= \min (90.53, 66.93)$ $= 66.93$ <p>[Ref. IS 800 : 2007, Cl. 10.3.2]</p>	
Long Joint Reduction Factor		$l_j = (n_r - 1) \times p$ $= (3 - 1) \times 75 = 150$ $l = 150$ $15 \times d = 15 \times 20 = 300$ <p>since, $l_j < 15 \times d$ then $\beta_{lj} = 1.0$</p> <p>[Ref. IS 800 : 2007, Cl. 10.3.3.1]</p>	
Large Grip Length Reduction Factor		$l_g = \Sigma (t_p + t_{member})$ $= 27.7$ $5d = 100$ $8d = 160$ <p>since, $l_g < 5d$; $\beta_{lg} = 1.0$</p> <p>[Ref. IS 800 : 2007, Cl. 10.3.3.2]</p>	Pass



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Bolt Capacity (post reduction factor) (kN)		$V_{rd} = \beta_{tj} \beta_{tg} V_{db}$ $= 1.0 \times 1.0 \times 66.93$ $= 66.93$	
Capacity (kN)	63.46	66.93	Pass

2.5 Bolt Design - Connected to Column

Check	Required	Provided	Remarks
Diameter (mm)		20	
Property Class		4.6	
Cleat Angle		90 x 90 x 10	
No. of Bolt Columns		1	
No. of Bolt Rows		3	
Min. Pitch Distance (mm)	$p_{min} = 2.5 d$ $= 2.5 \times 20$ $= 50.0$ [Ref IS 800 : 2007, Cl. 10.2.2]	75	Pass
Max. Pitch Distance (mm)	$p_{max} = \min(32 t, 300 \text{ mm})$ $= \min(32 \times 9.7, 300 \text{ mm})$ $= \min(310.4, 300 \text{ mm})$ $= 300$ Where, $t = \min(10.0, 9.7)$ [Ref. IS 800 : 2007, Cl. 10.2.3]	75	Pass
Min. Gauge Distance (mm)	$g_{min} = 2.5 d$ $= 2.5 \times 20$ $= 50.0$ [Ref IS 800 : 2007, Cl. 10.2.2]	N/A	



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Max. Gauge Distance (mm)	$g_{max} = \min(32 t, 300 \text{ mm})$ $= \min(32 \times 9.7, 300 \text{ mm})$ $= \min(310.4, 300 \text{ mm})$ $= 300$ <p>Where, $t = \min(10.0, 9.7)$</p> <p>[Ref. IS 800 : 2007, Cl. 10.2.3]</p>	N/A	
Min. End Distance (mm)	$e_{min} = 1.5 d_0$ $= 1.5 \times 22.0$ $= 33.0$ <p>[Ref. IS 800 : 2007, Cl. 10.2.4.2]</p>	35	Pass
Max. End Distance (mm)	$e_{max} = 12 t \varepsilon; \varepsilon = \sqrt{\frac{250}{f_y}}$ $e_1 = 12 \times 10.0 \times \sqrt{\frac{250}{250}} = 120.0$ $e_2 = 12 \times 9.7 \times \sqrt{\frac{250}{250}} = 116.4$ $e_{max} = \min(e_1, e_2) = 116.4$ <p>[Ref. IS 800 : 2007, Cl. 10.2.4.3]</p>	35	Pass
Min. Edge Distance (mm)	$e'_{min} = 1.5 d_0$ $= 1.5 \times 22.0$ $= 33.0$ <p>[Ref. IS 800 : 2007, Cl. 10.2.4.2]</p>	35	Pass



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Max. Edge Distance (mm)	$e'_{max} = 12 t \varepsilon; \varepsilon = \sqrt{\frac{250}{f_y}}$ $e_1 = 12 \times 10.0 \times \sqrt{\frac{250}{250}} = 120.0$ $e_2 = 12 \times 9.7 \times \sqrt{\frac{250}{250}} = 116.4$ $e'_{max} = \min(e_1, e_2) = 116.4$ <p>[Ref. IS 800 : 2007, Cl. 10.2.4.3]</p>	35	Pass
Moment Demand (kNm)		$M_d = (V_u \times ecc + M_w)$ <p><i>ecc = eccentricity</i> <i>M_w = external moment acting on web</i></p> $= \frac{(65.0 \times 10^3 \times 53.5 + 0.0 \times 10^6)}{10^6}$ $= 3477.5$	
Bolt Force Parameter(s) (mm)	$l_n = \text{length available}$ $l_n = p (n_r - 1)$ $= 75 \times (3 - 1)$ $= 150$ $y_{max} = l_n / 2$ $= 150 / 2$ $= 75.0$ $x_{max} = g(n_c - 1) / 2$ $= 0.0 \times (1 - 1) / 2$ $= 0.0$		



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Bolt.Force (kN)	$v_b v_u = V_u / (n_r \times n_c)$ $= \frac{130.0}{(3 \times 1)}$ $= 21.67$ $t_m h = \frac{M_d \times y_{max}}{\sum r_i^2}$ $= \frac{3477.5 \times 75.0}{11.25}$ $= 23.18$ $t_m v = \frac{M_d \times x_{max}}{\sum r_i^2}$ $= \frac{3477.5 \times 0.0}{11.25}$ $= 0.0$ $a_b h = \frac{A_u}{(n_r \times n_c)}$ $= \frac{0.0}{(3 \times 1)}$ $= 0.0$ $v_{res} = \sqrt{(v_b v_u + t_m v)^2 + (t_m h + a_b h)^2}$ $= \sqrt{(21.67 + 0.0)^2 + (23.18 + 0.0)^2}$ $= 31.73$		
Shear Capacity (kN)		$V_{dsb} = \frac{f_{ub} n_n A_{nb}}{\sqrt{3} \gamma_{mb}}$ $= \frac{400.0 \times 1 \times 245}{1000 \times \sqrt{3} \times 1.25}$ $= 45.26$ [Ref. IS 800 : 2007, Cl. 10.3.3]	



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Kb		$k_b = \min \left(\frac{e}{3d_0}, \frac{p}{3d_0} - 0.25, \frac{f_{ub}}{f_u}, 1.0 \right)$ $= \min \left(\frac{35}{3 \times 22.0}, \frac{75}{3 \times 22.0} - 0.25, \frac{400.0}{410}, 1.0 \right)$ $= \min(0.53, 0.89, 0.98, 1.0)$ $= 0.53$ <p>[Ref. IS 800 : 2007, Cl. 10.3.4]</p>	
Bearing Capacity (kN)		$V_{dpb} = \frac{2.5 k_b d t f_u}{\gamma_{mb}}$ $= \frac{2.5 \times 0.53 \times 20 \times 7.7 \times 410}{1000 \times 1.25}$ $= 84.31$ <p>[Ref. IS 800 : 2007, Cl. 10.3.4]</p>	
Capacity (kN)		$V_{db} = \min (V_{dsb}, V_{dpb})$ $= \min (45.26, 84.31)$ $= 45.26$ <p>[Ref. IS 800 : 2007, Cl. 10.3.2]</p>	
Long Joint Reduction Factor		$l_j = (n_r - 1) \times p$ $= (3 - 1) \times 75 = 150$ $l = 150$ $15 \times d = 15 \times 20 = 300$ <p>since, $l_j < 15 \times d$ then $\beta_{lj} = 1.0$</p> <p>[Ref. IS 800 : 2007, Cl. 10.3.3.1]</p>	
Large Grip Length Reduction Factor		$l_g = \Sigma (t_p + t_{member})$ $= 19.7$ $5d = 100$ $8d = 160$ <p>since, $l_g < 5d$; $\beta_{lg} = 1.0$</p> <p>[Ref. IS 800 : 2007, Cl. 10.3.3.2]</p>	Pass



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Bolt Capacity (post reduction factor) (kN)		$V_{rd} = \beta_{tj} \beta_{tg} V_{db}$ $= 1.0 \times 1.0 \times 45.26$ $= 45.26$	
Capacity (kN)	31.73	45.26	Pass

2.6 Cleat Angle Check

Check	Required	Provided	Remarks
Min. Cleat Angle Height	$0.6 \times (d_b - 2 \times t_f - 2 \times r_r)$ $= 0.6 \times (300.0 - 2 \times 13.1 - 2 \times 14.0)$ $= 147.48$ <i>[Ref. INSDAG – Chpt.5, Sect.5.2.3]</i>	220	Pass
Max. Cleat Angle Height	$d_b - 2(t_{bf} + r_{b1} + gap)$ $= 250.0 - 2 \times (9.7 + 10.0 + 10)$ $= 245.8$	220	Pass
Min. Leg Length (mm) on supported leg	$max(gap, t_{cleat} + r_{r-angle}) + 2e'_{min} + (n_c - 1)g_{min}$ $= max(10.0, 10.0 + 8.5) + 2 \times 33.0 + (1 - 1) \times 50.0$ $= 84.5$	90.0	Pass
Min. Leg Length (mm) on supporting leg	$t_{cleat} + r_{r-angle} + 2e'_{min} + (n_c - 1)g_{min}$ $= 10.0 + 8.5 + 2 \times 33.0 + (1 - 1) \times 50.0$ $= 84.5$	90.0	Pass
Min. Cleat Angle Thickness (mm)	$t_w = 0.5 \times 7.7 = 3.85$	10.0	Pass
Shear Yielding Capacity (kN)		$V_{dy} = \frac{A_v f_y}{\sqrt{3} \gamma_{mo}}$ $= \frac{2 \times 220 \times 10.0 \times 250}{\sqrt{3} \times 1.1 \times 1000}$ $= 577.35$ <i>[Ref.IS 800 : 2007, Cl.10.4.3]</i>	




Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

Check	Required	Provided	Remarks
Block Shear Capacity in Shear (kN)		$V_{dbl1} = \frac{A_{vg}f_y}{\sqrt{3}\gamma_{m0}} + \frac{0.9A_{tn}f_u}{\gamma_{m1}}$ $V_{dbl2} = \frac{0.9A_{vn}f_u}{\sqrt{3}\gamma_{m1}} + \frac{A_{tg}f_y}{\gamma_{m0}}$ $V_{db} = \min(V_{db1}, V_{db2}) = 602.22$ <p>[Ref. IS 800 : 2007, Cl. 6.4]</p>	
Shear Capacity (kN)	130.0	$V_d = \min(V_{dy}, V_{db})$ $= \min(577.35, 602.22)$ $= 577.35$ <p>[Ref. IS 800 : 2007, Cl. 6.1]</p>	Pass
Moment Capacity (kNm)	6.96	$M_{dzz} = \frac{\beta_b \times Z_p \times f_y}{\gamma_{mo} \times 10^6}$ $= \frac{1.0 \times 242000.0 \times 250}{1.1 \times 10^6}$ $= 55.0$ <p>[Ref. IS 800 : 2007, Cl. 8.2.1.2]</p>	Pass



Company Name	IIT Bombay	Project Title	Sample Connection Design
Group/Team Name	Osdag	Subtitle	Cleat Angle
Designer	Engineer #1	Job Number	1.1.3.1.1
Date	17 /12 /2020	Client	Yogesh D Pisal, Aker Powergas, Mumbai

3 3D Views

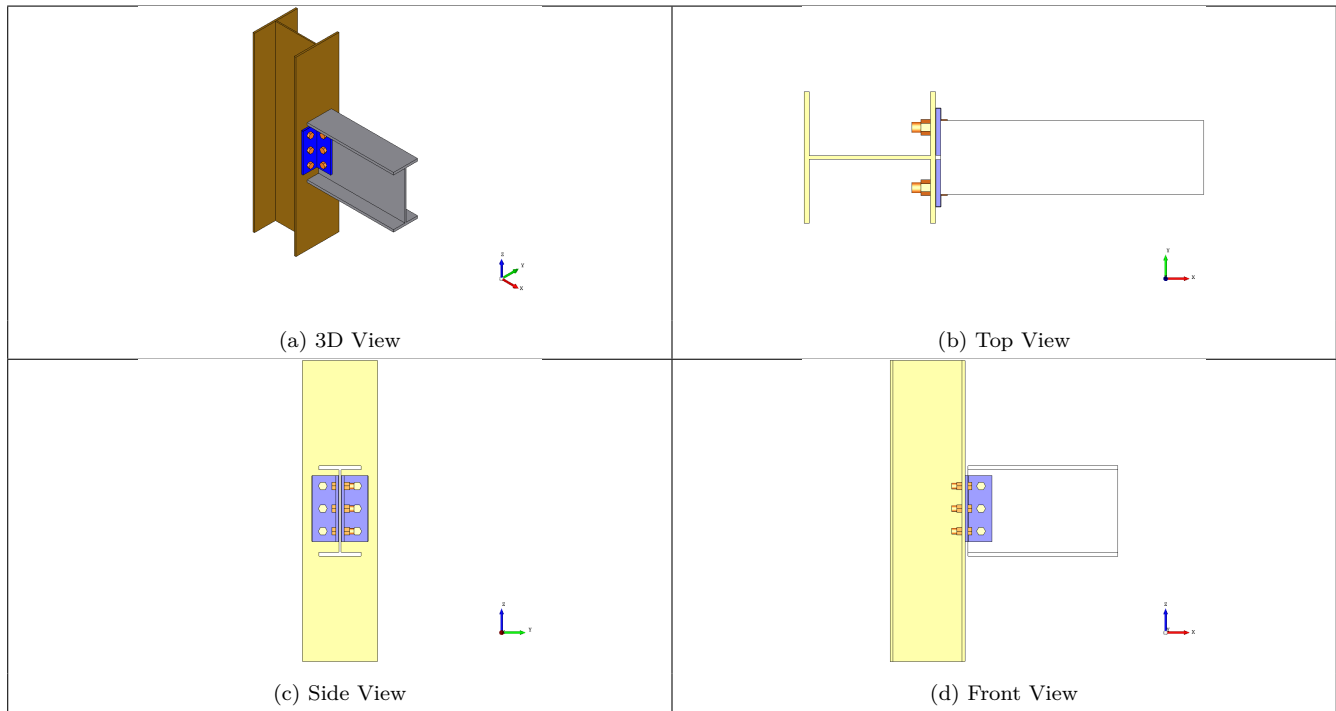

4 Design Log